

Installation Notes:

- 1) To fill or service bromine feeder, close inlet and outlet isolation valves (A&B). Open drain valve (E) to release pressure and open air release valve (C) to remove contents from feeder.
- 2) Once feeder is empty, remove o-ring sealed lid and replenish bromine tablets. Once completed, close drain and air release valves (C&E). Then open inlet and outlet isolation valves (A&B). Be sure to make that vessel is not leaking and lid is on securely.

A) Inlet Isolation Valve  
 B) Outlet Isolation Valve  
 C) Closure (Victaulic or Quick Closure)  
 D) Drain Valve  
 E) Floor Drain



PO Box 8697, Brea, CA 92822-5697  
 266 Viking Ave., Brea, CA 92821  
 Phone: 714-257-9165  
 Fax: 714-257-9215  
 www.gtpcompany.com

Appr. By: X  
 Date: X  
 Drwn By: JC  
 Date: 08/12/09  
 Scale: NTS  
 Rev.: A


Related Items:  
 X

Description:  
 Feeder Plumbing (Typical)  
 Model:  
 Bypass/Filter Feeder

Notes:  
 1) **\*\* Standard plumbing shown in diagram above, please contact factory for applying optional features, such as filters & flow indicators**

Notice  
 This drawing and it's content are for the specific use of GTP customers only. It is not to be duplicated or copied without expressed written consent of General Treatment Products, Inc. We Reserve the right to modify this drawing with out notice.

Rev.	Description	Date
A	X	X

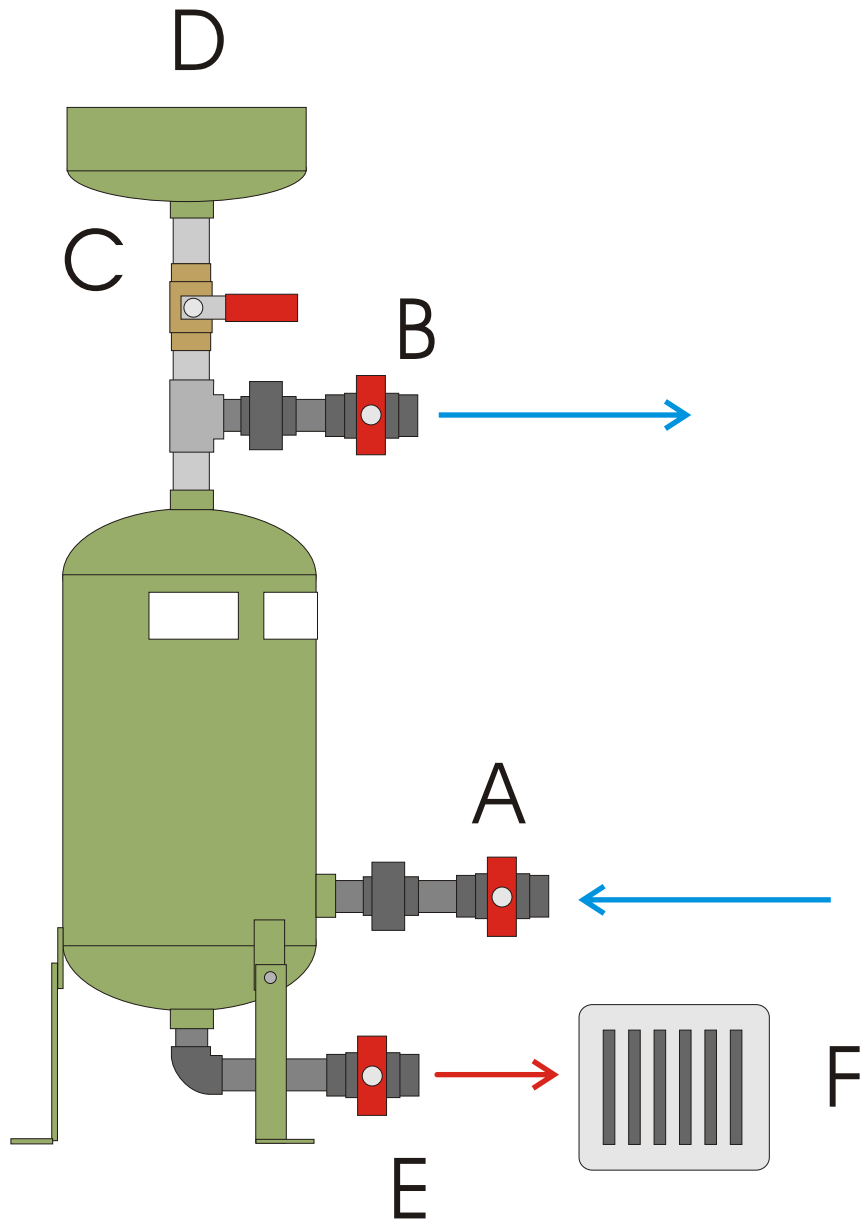

Installation Notes:

- 1) To fill or service bromine feeder, close inlet and outlet isolation valves (A&B). Open drain valve (E) to release pressure and open air release valve (C) to remove contents from feeder.
- 2) Once feeder is empty, remove o-ring sealed lid and replenish bromine tablets. Once completed, close drain and air release valves (C&E). Then open inlet and outlet isolation valves (A&B). Be sure to make that vessel is not leaking and lid is on securely.

A) Inlet Isolation Valve  
 B) Outlet Isolation Valve  
 C) Fill Valve  
 D) Fill Funnel  
 E) Drain Valve  
 F) Floor Drain



PO Box 8697, Brea, CA 92822-5697  
 266 Viking Ave., Brea, CA 92821  
 Phone: 714-257-9165  
 Fax: 714-257-9215  
 www.gtpcompany.com

Appr. By: X  
 Date: X  
 Drwn By: JC  
 Date: 08/12/09  
 Scale: NTS  
 Rev.: A

Related Items:  
 X

Description:  
 HP Feeder Plumbing (Typical)  
 Model:  
 HP Bypass Feeder

Notes:  
 1)

Notice  
 This drawing and it's content are for the specific use of GTP customers only. It is not to be duplicated or copied without expressed written consent of General Treatment Products, Inc. We Reserve the right to modify this drawing with out notice.

Rev.	Description	Date
A	X	X