


Plumb to  
pressure side  
of recirculation  
system



Installation:  
Max, Temp: 85F  
Max Pressure: 100PSI  
1) Plumb to pressure side of recirculation system. Plumbing should be a minimum of 1/2" pipe and be free of check valves, 10-20 FT in length and have no more than 4 elbows.  
2) Frame/stand should be firmly secured to floor pad with approved code fasteners.  
3) Although wheather resistant, glycol feed package should be located indoors to extend life.  
4) Set pressure switch (see instructions)  
5) Open isolation valve to system and turn pump switch to auto.  
**NOTE: DO NOT PLUMB SYSTEM RELIEF VALVES TO GLYCOL FEED PACKAGE**

12	X	X
11	X	X
10	Stand	Enamel paint carbon steel
9	LL Switch	Horizontal Polypro
8	Check Valve	1/2" spring loaded
7	Press Gauge	1/4" MNPT backtap
6	Outlet Valve	Isolation
5	Press Relief	Adjustable
4	Press Switch	Adjustable
3	Pump/Drain	Bronze gear pump/drain valve
2	Tank	Polyethylene w/hinged cover
1	Panel	115VAC NEMA 4
#	Part	Description

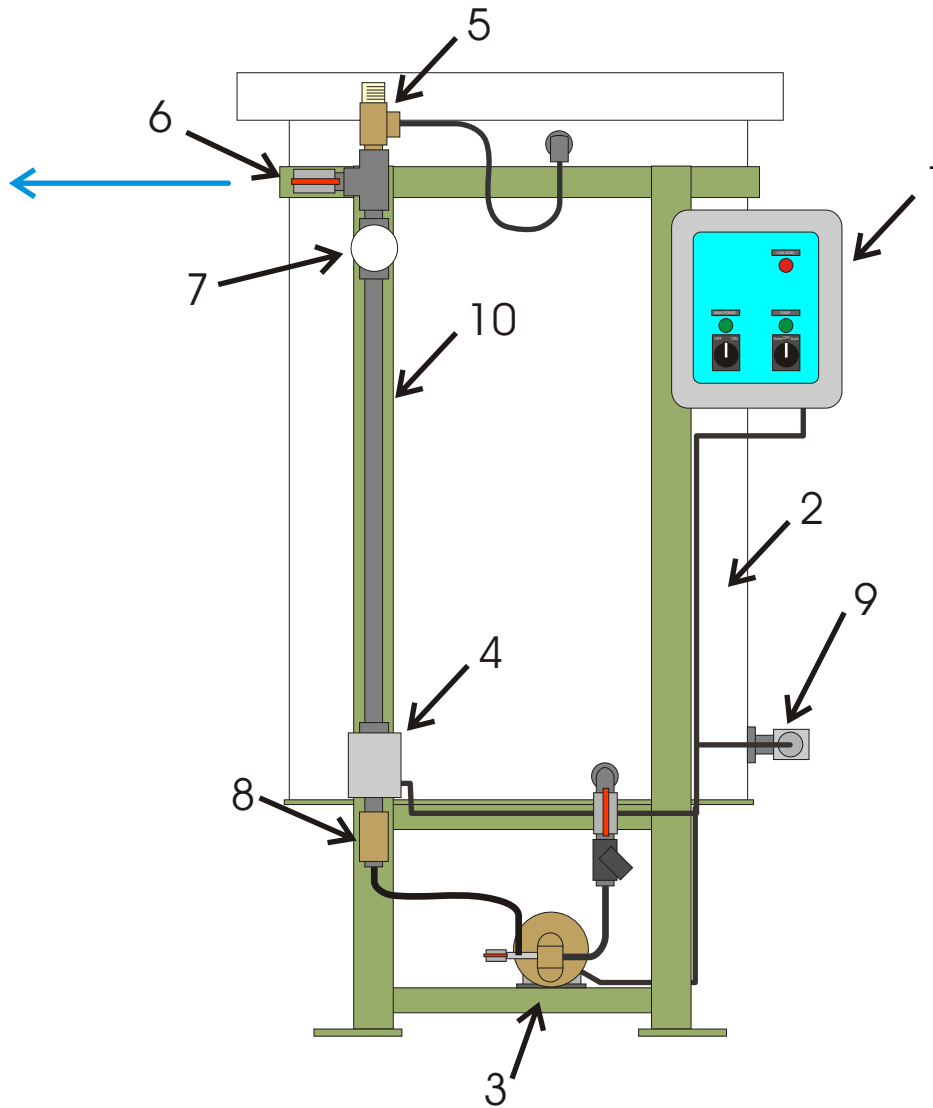

PO Box 8697, Brea, CA 92822-5697  
266 Viking Ave., Brea, CA 92821  
Phone: 714-257-9165  
Fax: 714-257-9215  
www.gtpcompany.com

Appr. By: X  
Date: X  
Drwn By: JC  
Date: 08/20/09  
Scale: NTS  
Rev: A

Related Items:  
X

Description:  
GP Industrial Glycol Feed Package  
Model:  
GPxx-E4-1


Notes:  
1)

**Notice**  
This drawing and it's content are for the specific use of GTP customers only. It is not to be duplicated or copied without expressed written content of General Treatment Products, Inc. We Reserve the right to modify this drawing with out notice.

A	X	X
Rev.	Description	Date



Plumb to pressure side of recirculation system

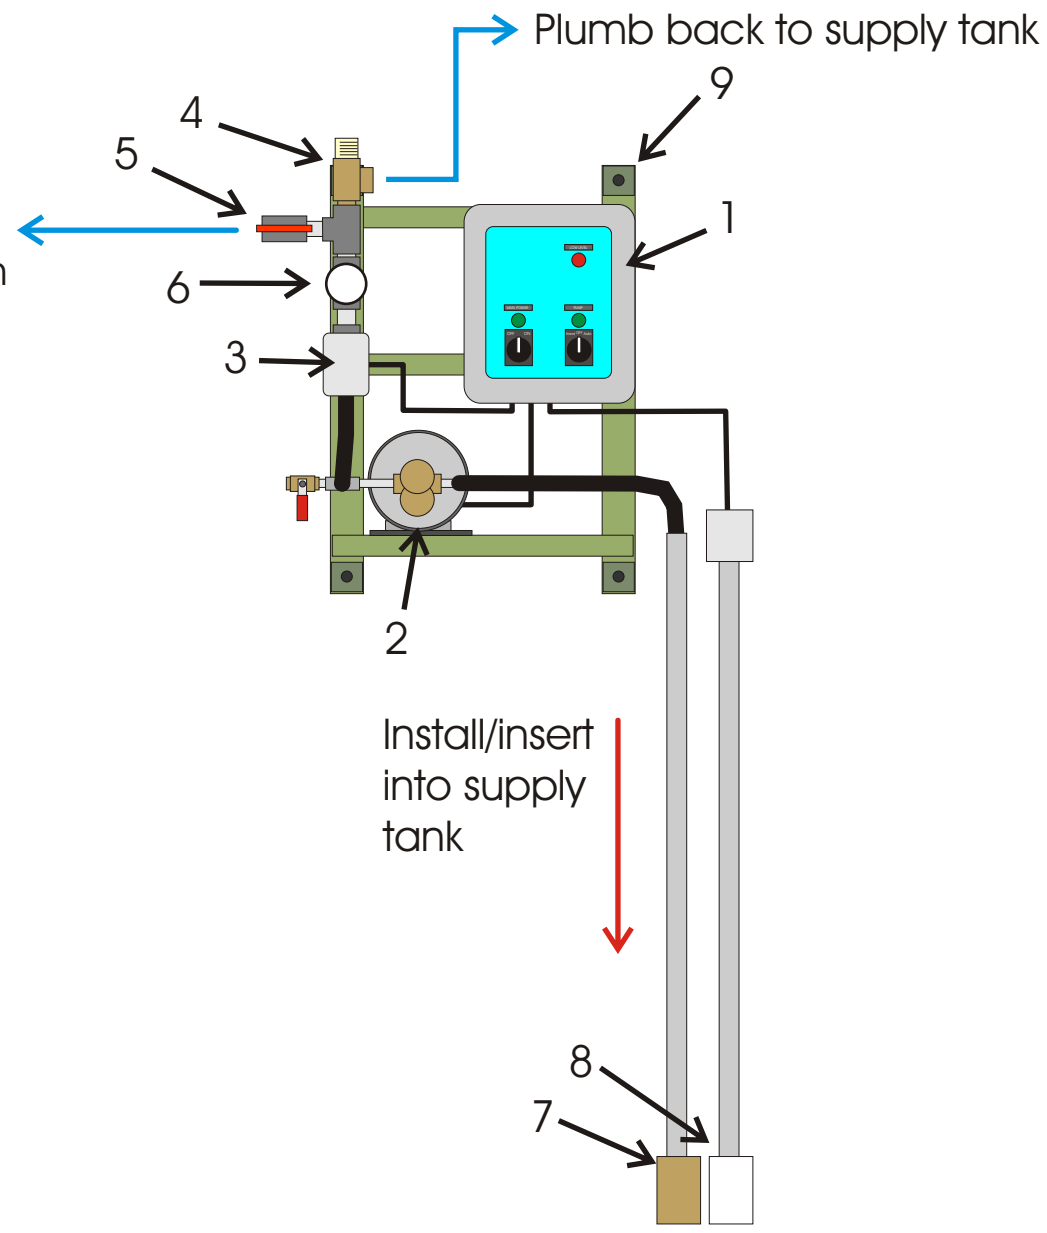

Installation:  
 Max, Temp: 85F  
 Max Pressure: 100PSI  
 1) Plumb to pressure side of recirculation system. Plumbing should be a minimum of 1/2" pipe and be free of check valves, 10-20 FT in length and have no more than 4 elbows.  
 2) Frame/stand should be firmly secured to floor pad with approved code fasteners.  
 3) Although wheather resistant, glycol feed package should be located indoors to extend life.  
 4) Set pressure switch (see instructions)  
 5) Open isolation valve to system and turn pump switch to auto.  
**NOTE: DO NOT PLUMB SYSTEM RELIEF VALVES TO GLYCOL FEED PACKAGE**

12	X	X
11	X	X
10	X	X
9	Frame	Carbon steel wall mount
8	LL Switch	Horizontal Polypro
7	Check Valve	1/2" spring loaded
6	Press Gauge	1/4" MNPT backtap
5	Outlet Valve	Isolation
4	Press Relief	Adjustable
3	Press Switch	Adjustable
2	Pump/Prime	Bronze gear pump/prime valve
1	Panel	115VAC NEMA 4
#	Part	Description



GENERAL TREATMENT PRODUCTS, INC.  
 PO Box 8697, Brea, CA 92822-5697  
 266 Viking Ave., Brea, CA 92821  
 Phone: 714-257-9165  
 Fax: 714-257-9215  
 www.gtpcompany.com

Appr. By: X	Related Items: X
Date: X	
Drwn By: JC	
Date: 08/20/09	
Scale: NTS	
Rev: A	

Notes:  
 1)

**Notice**  
 This drawing and it's content are for the specific use of GTP customers only. It is not to be duplicated or copied without expressed written content of General Treatment Products, Inc. We Reserve the right to modify this drawing with out notice.

Description:  
 GX Wall Mount Industrial Glycol Feed Package  
 Model:  
 GX-E4-1

A	X	X
Rev.	Description	Date